



SOLAR RATING
& CERTIFICATION
CORPORATION

OG-100 ICC-SRCC™ CERTIFIED SOLAR AIR HEATING COLLECTOR #10001914

SUPPLIER:
 ATAS International
 6612 Snowdrift Road
 Allentown, PA 18106
 USA
 ATAS.com

BRAND: ATAS International
MODEL: BWS390
COLLECTOR TYPE: Air Transpired
CERTIFICATION NUMBER: 10001914
ORIGINAL CERTIFICATION DATE: Apr. 07, 2014
RENEWAL EXPIRATION DATE: Apr. 30, 2019
Certifications are subject to annual renewal

The solar collector listed below has been evaluated by the Solar Rating & Certification Corporation™ (ICC-SRCC™), an ISO 17065 accredited Certification Body, in accordance with ICC-SRCC OG-100, Operating Guidelines and Minimum Standards for Certifying Solar Collectors, and has been certified by ICC-SRCC. This award of certification is subject to all terms and conditions of the OG-100 Program Agreement and the documents incorporated therein by reference. This document must be reproduced in its entirety.

OG-100 COLLECTOR EFFICIENCY RATINGS¹ (η) – Black Absorber Color²

Wind Speed ³ ►	Low Wind (1.0 m/s, 2.2 mph)	Medium Wind (2.0 m/s, 4.5 mph)	High Wind (3.0 m/s, 6.7 mph)
Air Flow Rate			
1.2 scmm/m ² (4.0 scfm/ft ²)	0.61	0.57	0.47
1.8 scmm/m ² (6.0 scfm/ft ²)	0.72	0.69	0.59
2.4 scmm/m ² (8.0 scfm/ft ²)	0.82	0.77	0.67

1: Thermal efficiency (η) is based on aperture area and includes back losses.

2: Efficiency ratings are based on test data for the specific collector described in the "Collector Test Sample Details" section below.



Performance values for collectors that use an absorber painted a different color than the one tested can be estimated by multiplying the efficiency values above by the ratio of the absorptivity of the new paint color and the absorptivity of the tested collector (0.95 in this case). This assumes that the new color paint has a similar emissivity to the tested collector (0.88 in this case), the absorbers in each stage are the same color. Absorptivity should be measured per ASTM C1549.

3. Efficiency data adjusted to 1.0, 2.0, 3.0 m/s speeds by means of linear interpolation. Original data available in Testing Summary below.

CERTIFIED COLLECTOR SPECIFICATIONS

In order to be considered certified, installed collectors must match the following specifications. Collectors must match the design of the sample tested for certification.

Type	<input checked="" type="checkbox"/> Unglazed <input type="checkbox"/> Glazed
Description	1-Stage Open-Loop Transpired Solar Air Heating Collector
Air Flowrate Range	1.2 to 2.4 scmm/m ² (4 to 8 scfm/ft ²)
Panel Width	1.0 m (39.375 in)
Panel Length	1.8 to 12.2 m (6 to 40 ft)
Air Inlet	Transpired – Absorber perforations
Air Outlet	Variable
Installation Orientation	0° (horizontal) to 90° (vertical)
ABSORBER	
Type	Painted perforated plate
Material	Aluminum plate, 1.0 mm (0.032") thick,

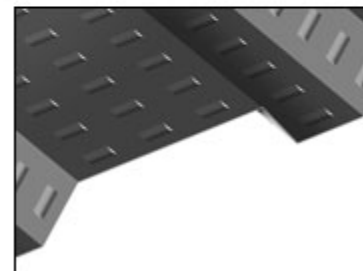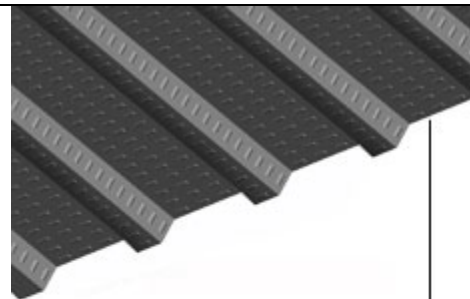

* Data supplied by collector manufacturer and was not measured independently by the test laboratory.



SOLAR RATING
& CERTIFICATION
CORPORATION


TESTING SUMMARY

ATAS BWS390 COLLECTOR

ICC-SRCC OG-100 CERTIFICATION #10001914

Test Lab	Exova Canada, Inc.	Laboratory testing of a collector sample is required for OG-100 certification to confirm that the collector passes qualification tests and to obtain performance results. The following sections provide information on the collector tested for the purposes of OG-100 certification.
Test Report Number	13-06-S0006A	
Test Report Date	November 20, 2013	
Test Standard	CSA F378-1987, ISO 9806-1, -03	

COLLECTOR TEST SAMPLE DETAILS		
Absorber	Coating	Paint: Black PVDF
	Absorptivity	0.95*
	Material	Aluminum, 1.0 mm (0.032") thick
	Porosity	Not Reported
	Profile	BWS390
Gross Area		7.981 m ² (85.90 ft ²)
Aperture Area (Net)		7.981 m ² (85.90 ft ²)
Gross Sample Dimensions (LXWXH)		2.825 m x 2.825 m x 13.5 cm (9.30 ft x 9.30 ft x 5.31 in)
Dry Weight		86.59 kg (190.9 lb)
THERMAL EFFICIENCY TESTING DETAILS		
Testing Location		Indoors, conditioned space (20° C)
Added Back Insulation		2" rigid foam

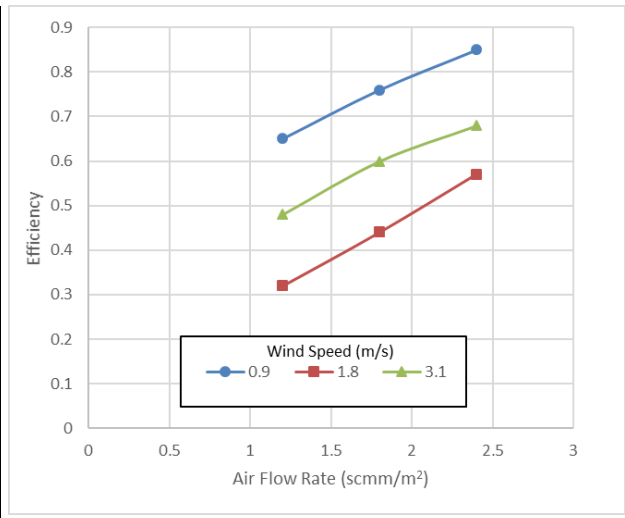

THERMAL EFFICIENCY DATA SUMMARY (900 W/m ² average insolation)							
Wind Speed		0.9 m/s (2.0 mph)		1.8 m/s (4.0 mph)		3.1m/s (6.9 mph)	
		η	ΔT (K)**	η	ΔT (K)**	η	ΔT (K)**
Air Flow	1.2 scmm/m ² (4.0 scfm/ft ²)	0.65	23.1	0.57	20.1	0.48	17.0
	1.8 scmm/m ² (6.0 scfm/ft ²)	0.76	18.2	0.69	16.4	0.60	14.2
	2.4 scmm/m ² (8.0 scfm/ft ²)	0.85	15.3	0.77	13.9	0.68	12.4

* Data supplied by coating manufacturer and was not measured independently by the test laboratory.
 ** ΔT defined as $T_e - T_a$ where T_e is the temperature of the air exiting the collector and T_a is the ambient (inlet) air temperature.

REMARKS:

- Performance is unreliable if the collector is used at a pressure drop of less than 25 Pa.
- Wind impact on efficiency should not be extrapolated to large-scale systems because the ratio of wind-blown edge loss to gain across the surface area is diminished for large vs. small collectors (arrays).
- All lengths of this collector are certified.

Shawn Martin

Vice President of Technical Services, ICC-SRCC

